



# WATER FOR LIVING

Drinking Water  
Consumer Confidence Report (CCR)  
City of Columbus, Ohio



# 2015



Scan to Learn More

# YOUR 2015 WATER REPORT

The goal of the Division of Water is to ensure that any contaminants in your drinking water are restricted below a level at which there is no known health risk. This report shows the types and amounts of key elements in your water supply, their likely sources and the maximum contaminant level (MCL) that the EPA considers safe. The water delivered to your home meets ALL of the requirements of the Safe Drinking Water Act (SDWA). We use a complex multi-barrier treatment process to assure safe drinking water is delivered to our customers. If for any reason the standards are not met, the public will be notified.

Please share this information with other people who drink this water, especially those who may not have received it directly (for example, people in apartments, nursing homes, schools and businesses). You can do so by posting this report in a public place or distributing copies by hand or mail. You can request additional copies by calling customer service at (614) 645-8276 or email to [utilityleadrep@columbus.gov](mailto:utilityleadrep@columbus.gov) or view online at [www.columbus.gov/CCR/](http://www.columbus.gov/CCR/).

## WATER FIRST FOR THIRST

Water is the original sports drink - it contains no fat, calories, added sugars or cholesterol. It hydrates skin cells, regulates body temperature, helps the body absorb nutrients and flush out waste. Drinking plenty of water may even help you lose weight, manage stress and give you an energy boost.

With all the health benefits of water, it's easy to see why choosing water over sugary drinks is good for your health. Drinking too much soda, juice and other sugary drinks has been linked to obesity which can lead to diabetes, heart disease and stroke. What can you do? Drink more water, and when your child says, "I'm thirsty," offer water before any other drink. You can also make water fun:

- Add sliced citrus fruits or berries for flavor; or freeze them in ice cubes
- Put in fresh mint or basil to jazz things up
- Have children decorate their own water cup

To learn more visit Columbus Public Health online at [www.columbus.gov/publichealth/Water-First-for-Thirst/](http://www.columbus.gov/publichealth/Water-First-for-Thirst/).

## TAP WATER - THE BEST DEAL AROUND

On average, a gallon of tap water in the greater Columbus area costs about one-third of a cent per gallon. When compared to the cost of other products we consume every day, tap water is quite a bargain.

**A gallon of tap water costs \$0.00357.**

A GALLON OF



\$8.00

A GALLON OF



\$7.57

A GALLON OF



\$10.67

A GALLON OF




\$5.99



\$0.00357

# HOW TO CONTACT US

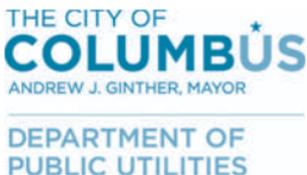

**Division of Water**  
910 Dublin Road  
Columbus, OH 43215

**Andrew J. Ginther**  
Mayor, City of Columbus

**Tracie Davies**  
Director, Department of Public Utilities

**Richard C. Westerfield, P.E., Ph.D.**  
Administrator, Division of Water

---

We're interested in your questions and concerns about your water.  
For questions, please call the **Water Quality Assurance Lab** at **(614) 645-7691**,  
or visit our website at [www.columbus.gov/DrinkingWater/](http://www.columbus.gov/DrinkingWater/).

For questions involving billing, accounts, service calls, bill payments,  
and additional CCR copies please contact **Customer Service** at: **(614) 645-8276**.

For questions involving water emergencies, waterline breaks, hydrant damage or leaks,  
please contact **Distribution Maintenance** at: **(614) 645-7788**.

Call 311 for City Services or (614) 645-3111, or visit the web at [www.311.columbus.gov](http://www.311.columbus.gov).

## SEWER AND WATER ADVISORY BOARD

In 1984, the City of Columbus formed the Columbus Sewer and Water Advisory Board (SWAB) to oversee the operations and rate structures of both the Divisions of Water and Sewerage and Drainage. The board, comprised of city officials and six Columbus residents who represent different constituencies — such as senior citizens and the business community — meets quarterly to advise the Divisions on business decisions and best practices. Chaired in 2015 by Ohio State University's Wallace Giffen, the board forwards their recommendation to Columbus City Council, who then deliberate to officially set rates or change fundamental policy.

SWAB meetings are open to the public; call (614) 645-7541 for a schedule of meeting times and dates.

## WHAT'S NOT IN YOUR WATER

Reports on TV and in the press often raise concerns about the health risks associated with the presence of certain minerals, chemicals, or other contaminants in your food or water. The Columbus Division of Water performs tens of thousands of tests each year to ensure drinking water quality. Many substances for which the division tests never appear in this report because they are not found in the drinking water. For example, there are 51 volatile organic chemicals as well as arsenic, perchlorate, asbestos, MTBE, radium 228, and ammonia (just to name a few) that are NOT found in your drinking water.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include: microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife; inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming; pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses; organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems; and radioactive contaminants, which can be naturally occurring or the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, USEPA prescribes regulations which limit the amount of certain contaminants in drinking water provided by public water systems. FDA regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's Safe Drinking Water Hotline at (800) 426-4791.

## LEAD IN THE HOME

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The City of Columbus is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting

for several hours, you may minimize exposure by flushing your tap for thirty seconds to two minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. A list of laboratories certified in the State of Ohio to test for lead may be found at <http://www.epa.ohio.gov/ddagw/labcert.aspx> or by calling (614) 644-2752. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline at 1(800) 426-4791 or at <https://www.epa.gov/safewater/lead>.

The lead concentration in the drinking water leaving our water treatment plants is below the level of detection. Most homes in the Columbus area do not have lead service lines and have little to no detectable levels of lead in their tap water.

You can also call (614) 645-8276 for your free copy of "What You Need to Know About Lead in Drinking Water." This information can also be found online at [www.columbus.gov/drinkingwater/](http://www.columbus.gov/drinkingwater/) in the Common Water Quality Concerns feature, "Lead in Drinking Water."

## TURBIDITY

Utilities that treat surface water and/or filter the water are required to monitor for turbidity which is a measure of the cloudiness of water and is an indication of the effectiveness of our filtration system. The turbidity limit set by the EPA is 0.3 NTU in 95% of the daily samples and shall not exceed 1 NTU at any time. The highest recorded turbidity for HCWP was 0.15 NTU and the lowest monthly percentage of samples meeting the standard was 100%. The highest recorded turbidity for DRWP was 0.15 NTU and the lowest monthly percentage of samples meeting the standard was 100%.

### Public Notice - Drinking Water Notice - May 1, 2016 Columbus Public Water System Did Not Meet Monitoring Requirements

We are required to monitor your drinking water for turbidity on a regular basis. Results of regular monitoring are an indicator of whether or not your drinking water meets health standards. Recently, on May 1, 2016, the HCWP failed to take the appropriate number of samples for turbidity due to an equipment failure.

#### What Should I Do?

There is nothing you need to do at this time. You do not need to boil your water or take other corrective action. This notice is to inform you that the Columbus Public Water System did not monitor results for an individual filter which occurred on May 1, 2016 as required by the Ohio Environmental Protection Agency (OEPA). Turbidity has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms. These organisms include bacteria, viruses, and parasites that can cause symptoms such as nausea, cramps, diarrhea and associated headaches.

#### What is Being Done?

Upon notifying the OEPA of this violation, we were directed to perform monitoring and reporting of turbidity, as required. We have taken steps to ensure that adequate monitoring will be performed in the future.

The City of Columbus has a current, unconditioned

## TOTAL ORGANIC CARBON

The value reported under “Level Found” for Total Organic Carbon (TOC) is the lowest running annual average ratio between the percentage of TOC actually removed to the percentage of TOC required to be removed. A value of greater than one indicates that the water system is in compliance with TOC removal requirements. A value of less than one indicates a violation of the TOC removal requirements. The value reported under “Range” for TOC is the lowest monthly ratio to the highest monthly ratio.

## NEWBORNS AND NITRATE

Nitrate in drinking water at levels above 10 ppm is a health risk for infants less than six months of age. Infants below the age of six months who drink water containing nitrate in excess of the MCL could become seriously ill and if untreated, may die. Symptoms include shortness of breath and blue-baby syndrome. Nitrate levels may rise quickly for short periods of time because of rainfall or agricultural activity. Local television, radio and print media will be notified within 24 hours if the level of nitrate rises above 10 ppm. The media will similarly be notified once the level decreases. If you are caring for an infant you should seek advice from your health care provider.

The Dublin Road Water Plant exceeded the nitrate MCL of 10 ppm from June 8 to June 22, 2015. Water from the HCWP and PAWP did not exceed the MCL in 2015.

Additional information about nitrates can be found online at [www.columbus.gov/nitrateFAQs/](http://www.columbus.gov/nitrateFAQs/) or visit [www.columbus.gov/drinkingwater/](http://www.columbus.gov/drinkingwater/) and look under Common Water Quality Concerns for the Elevated Nitrate Levels feature.

## HEALTH CONCERNS

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised individuals such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, persons with HIV/AIDS or other immune system disorders, some elderly and infants can be particularly at risk from infection. These people should seek advice from their health care providers about drinking water.

*Cryptosporidium* (“Crypto”), for example, is a microscopic organism that, when ingested, can result in diarrhea, fever, and other gastrointestinal symptoms. Crypto comes from animal waste in the watershed and may be found in our source water. Crypto is eliminated by using a multi-barrier water treatment process including coagulation, sedimentation, softening, filtration and disinfection. EPA/CDC guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline at 1(800) 426-4791.

Columbus’ water is regularly tested for organisms that could be harmful to people – including *Cryptosporidium*. Crypto was detected 10 out of 24 times in the Scioto River and 11 out of 24 times in Big Walnut Creek. Also, Crypto was not detected in the DRWP tap water but was detected in 1 out of 11 times in the HCWP tap water. It should be noted, the presence in tap water was minimal and current testing methods do not enable us to determine if the organisms are viable.

## WATER QUALITY ASSURANCE

The City of Columbus’ Water Quality Assurance Laboratory (WQAL) is a large modern water lab with a long history of distinguished public service starting under the noted water quality chemist Charles Hoover. The lab continues to maintain that tradition of excellence and technical innovation in the ongoing use of state-of-the-art equipment for water analysis, while continuing to research the latest advancements in water treatment techniques.

The WQAL performs water quality monitoring and treatment research to ensure that Columbus’ drinking water meets or is better than all federally mandated Safe Drinking Water Act (SDWA) standards. The WQAL also provides water quality information to the water treatment plants and addresses customer complaints and inquiries regarding water quality. In 2015, the WQAL’s EPA licensed and certified laboratory staff completed over 46,000 analyses relating to 32 different organic, inorganic, and microbiological water quality parameters.

To maintain compliance with current SDWA regulations, WQAL activities in 2015 were again directed at developing information regarding new and upcoming rules. These include the Unregulated Contaminant Monitoring Rule (UCMR), Stage 2 of the Disinfectant/Disinfection Byproducts Rule (D/DBP), and the Long Term 2 Enhanced Surface Water Treatment Rule (LT2ESWTR). Additionally, the lab has been closely involved in planning the improvement of watershed and water distribution system surveillance and detection measures for security concerns in the wake of 9/11 and the associated heightened security protocols.

As with the WQAL staff, the State of Ohio licenses and certifies the water plant operators who are charged with running and maintaining each of the three water treatment plants. These operators also perform the critical task of treatment and process monitoring to insure that the water leaving the plant is of the highest quality. In order to stay current in the ever-changing technical field of water purification, these operators spend many hours of continuing education in the classroom every year.

***These operators, the Water Quality Assurance Laboratory staff, and all of the Division of Water employees are dedicated to providing WATER, a life-sustaining resource, for the well-being and economic vitality of the community. This is our mission.***

**License to operate our public water system.**

## PRIMARY DRINKING WATER STANDARDS

Substances we detected (units)	When we checked	What's allowed? (MCL)	What's the goal? (MCLG)	Dublin Road Water Plant		Hap Cremean Water Plant		Parsons Avenue Water Plant		Violation?	Where did it come from?
				Level Found	Range	Level Found	Range	Level Found	Range		
Fluoride (ppm)	2015	4	4	0.92	0.80 - 0.99	0.91	0.75 - 0.96	0.92	0.82 - 1.05	No	Water additive – protects teeth
Nitrate (ppm)	2015	10	10	12.3 <sup>1</sup>	<0.5 - 12.5	1.7	<0.5 - 1.7	ND	ND	Yes <sup>1</sup>	Agricultural fertilizer runoff
Simazine (ppb)	2015	4	4	<0.10	<0.10 - 1.17	<0.10	<0.10 - 0.18	ND	ND	No	Agricultural herbicide runoff
Atrazine (ppb)	2015	3	3	0.33	<0.10 - 1.35	0.12	<0.10 - 0.46	ND	ND	No	Agricultural herbicide runoff
Alachlor (ppb)	2015	2	0	ND	ND	ND	ND	ND	ND	No	Agricultural herbicide runoff
Metolachlor (ppb)	2015	No set level	No goal set	<0.20	<0.20 - 0.72	<0.20	<0.20 - 0.33	ND	ND	No	Agricultural herbicide runoff
Metribuzin (ppb)	2015	No set level	No goal set	<0.10	<0.10 - 0.23	ND	ND	ND	ND	No	Agricultural herbicide runoff
Total Trihalomethanes (ppb)	2015	80	No goal set	71.4	27.0 - 111.0	58.9	33.7 - 87.7	24.4	16.7 - 33.8	No	By-product of drinking water disinfection
Total Haloacetic Acids (ppb)	2015	60	No goal set	38.8	11.2 - 56.8	50.5	29.5 - 65.2	6.5	5.1 - 7.2	No	By-product of drinking water disinfection
Total Organic Carbon	2015	TT (removal ratio >1)	No goal set	2.48	2.45 - 3.43	2.71	2.27 - 3.93	N/A	N/A	No	Naturally present in environment
Total Coliform Bacteria	2015	Present in <5% of monthly samples	0%	0.0%	0.0 - 0.9% <sup>2</sup>	0.0%	0.0 - 0.0%	0.0%	0.0 - 0.0%	No	Bacteria present in environment
Total Chlorine (ppm)	2015	4 (MRDL)	4 (MRDLG)	1.50	0.34 - 2.20	1.59	0.34 - 2.30	1.12	0.36 - 2.03	No	Disinfectant
Turbidity (NTU)	2015	TT (<1 NTU)	No goal set	0.15	0.01 - 0.15	0.15	0.03 - 0.15	N/A	N/A	No	Soil runoff
		TT (% meeting Std.)	No goal set	100%	100 - 100%	100%	100 - 100%	N/A	N/A		
Substances we detected (units)	When we checked	Action Level (AL)	What's the goal? (MCLG)	Concentration at 90 <sup>th</sup> percentile		Range		# of sites found above the Action Level		Violation?	Where did it come from?
Lead (ppb)	2014	15	0	< 1		< 1 - 2.7		0 out of 50		No	Corrosion of household plumbing
Copper (ppm)	2014	1.3	1.3	0.054		0.002 - 0.079		0 out of 50		No	Corrosion of household plumbing; Erosion of natural deposits

<sup>1</sup> **Nitrate Violation.** June 8<sup>th</sup> to June 22<sup>nd</sup> of 2015, drinking water from the Dublin Road Water Plant exceeded the nitrate MCL of 10 ppm. (Water supplied by the Hap Cremean and Parsons Avenue plants did not exceed the MCL.)

<sup>2</sup> One (1) sample out of 113 in November 2015 indicated the presence of coliform bacteria = 1 / 1,384 for the year.

## OTHER WATER QUALITY PARAMETERS OF INTEREST

Substances we detected (units)	When we checked	What's allowed? (MCL)	What's the goal? (MCLG)	Dublin Road Water Plant		Hap Cremean Water Plant		Parsons Avenue Water Plant		Where did it come from?
				Annual Average	Range	Annual Average	Range	Annual Average	Range	
pH (units)	2015	7.0 - 10.5 (SMCL)	No goal set	7.8	7.7 - 7.8	7.7	7.5 - 7.8	7.8	7.7 - 7.9	Treatment process
Hardness	2015	No set level	No goal set	12.1	115 - 124	104	91 - 130	122	121 - 124	Naturally occurring
				(ppm)	(ppg)	7.1	6.7 - 7.3	6.1	5.3 - 7.6	
Sodium (ppm)	2015	No set level	No goal set	70.8	22.6 - 112.3	18.0	13.0 - 30.0	97.3	76.3 - 111.5	Natural/Treatment process

If you have any questions about this data please call the Columbus Water Quality Assurance Lab at (614) 645-7691, or [www.columbus.gov/PublicUtilities/](http://www.columbus.gov/PublicUtilities/).

## UNREGULATED CONTAMINANT MONITORING RULE (REQUIRED MONITORING)

Substances we detected (units)	When we checked	What's allowed? (MCL)	What's the goal? (MCLG)	Dublin Road Water Plant		Hap Cremean Water Plant		Parsons Avenue Water Plant		Violation?	Where did it come from?
				Level Found	Range	Level Found	Range	Level Found	Range		
Chlorate (ppb)	2014	No set level	No goal set	227	78 - 370	ND	ND	ND	ND	No	Agricultural defoliant or desiccant
Chromium (ppb)	2014	No set level	No goal set	0.39	0.24 - 0.58	0.29	0.22 - 0.35	0.45	0.34 - 0.56	No	Naturally occurring element; Steel production
Hexavalent Chromium (ppb)	2014	No set level	No goal set	0.25	0.12 - 0.35	0.19	0.15 - 0.24	0.15	0.10 - 0.18	No	Chrome plating; dyes & pigments; wood preservation
Molybdenum (ppb)	2014	No set level	No goal set	7.5	4.1 - 12.0	5.8	4.2 - 7.6	9.9	8.5 - 12.0	No	Naturally occurring element found in ores and present in plants, animals, & bacteria
Strontium	2014	No set level	No goal set	712	15 - 1,300	169	150 - 180	410	370 - 480	No	Naturally occurring element
Vanadium (ppb)	2014	No set level	No goal set	0.49	0.37 - 0.62	0.50	0.37 - 0.69	ND	ND	No	Naturally occurring elemental metal
1,4-Dioxane (ppb)	2014	No set level	No goal set	0.12	N/A	ND	ND	0.09	0.07 - 0.10	No	Used as a solvent or solvent stabilizer in manufacture and processing of paper, cotton, textile products, automotive coolant, cosmetics and shampoos

**UCMR 3 Monitoring** In 2014 the City of Columbus, Division of Water was required to participate in the third Unregulated Contaminant Monitoring Rule 3 (UCMR 3.) Unregulated contaminants are those for which EPA has not established drinking water standards. The purpose of unregulated contaminant monitoring is to assist EPA in determining the occurrence of unregulated contaminants in drinking water and whether future regulation is warranted.

## DEFINITIONS AND TERMS

- Action Level (AL) ..... The concentration of a contaminant, which if exceeded, triggers treatment or other requirements that a water system must follow.
- Maximum Contaminant Level ..... The level of a contaminant in drinking water, below which there is no known Goal or expected health risk.
- Goal (MCLG) ..... MCLGs allow for a margin of safety.
- Maximum Contaminant Level ..... The highest level of contaminant that is allowed in drinking water. MCLs are set as close to the MCLG as feasible using the best available treatment technology.
- Secondary MCL (SMCL) ..... A nonenforceable numerical limit set by the USEPA for a contaminant on the basis of aesthetic effects to prevent an undesirable taste, odor, or appearance.
- N/A ..... Not Applicable
- ND ..... No Detect
- NTU ..... Nephelometric Turbidity Unit (a measure of particles held in suspension in water).
- Parts per Billion (ppb) or ..... Are units of measurement for concentration of a contaminant. A part per billion corresponds to one second in roughly 31.7 years.
- Micrograms per Liter (ug/L)
- Parts per Million (ppm) or ..... Are units of measurement for concentration of a contaminant. A part per million corresponds to one second in roughly 11.5 days.
- Milligrams per Liter (mg/L)
- Grains per Gallon (gpg) ..... A non-metric unit of measurement for hardness used in North America.
- MRDL ..... Maximum Residual Disinfectant Level: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
- MRDLG ..... Maximum Residual Disinfectant Level Goal: The level of drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
- The ">" symbol ..... This symbol means "greater than."
- The "<" symbol ..... This symbol means "less than." For example, a result of < 5 means that the lowest level that could be detected was 5 and the contaminant in that sample was not detected.
- Treatment Technique (TT) ..... A required process intended to reduce the level of a contaminant in drinking water. For Total Organic Carbon (TOC) the level must be above 1. For turbidity the level must be under 0.3 NTU 95% of the time, and always < 1 NTU.
- Turbidity ..... A measurement of the cloudiness of the water. We monitor turbidity because it is a good indication of water quality and the effectiveness of our treatment process.

## THE WATER SERVICE AREA MAP

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. Each home, school and business in the greater Columbus area receives water from one of the following three water plants:

- Dublin Road Water Plant (DRWP) serves northwestern and southwestern residents using water from Griggs and O'Shaughnessy Reservoirs.
- Hap Cremean Water Plant (HCWP) serves OSU and northern residents. The water source is the Hoover Reservoir.
- Parsons Avenue Water Plant (PAWP) draws water from wells and serves residents in the southeast.



# THE WATER TREATMENT PROCESS

Water flows (1) to the treatment plant from the reservoir or stream through rotating screens (2) to remove large debris. It is then pumped into the plant where alum is added (3) to cause coagulation. After rapid mixing, the water remains in the settling basin (4) while sedimentation of floc occurs (2-4 hours). The water treatment residual (settled floc) is pumped from the bottom of the pools and stored in holding lagoons to dry.


The softening process (5) involves the addition of sodium carbonate (soda ash) or caustic soda and hydrated lime to remove calcium and magnesium ions that are responsible for water hardness. This process takes an additional 2-4 hours. For each pound of chemical used in the treatment process, two pounds are removed.

After an additional sedimentation process, carbon dioxide is added (6) to lower the pH level to approximately 7.8. Water is held in a stabilizing basin (7) for another 2-4 hours.

Water then flows through large dual-media rapid sand filters made up of layers of gravel, sand and anthracite coal (8).

Addition of chlorine to disinfect the water, fluoride as required and a corrosion inhibitor take place at the end of the process (9) before water enters large underground clearwells (10) to be held until needed by the community (11).

Please note: When ground water is used (as in the case of the Parsons Avenue Water Plant), neither screening (2) nor initial sedimentation (3,4) is needed.

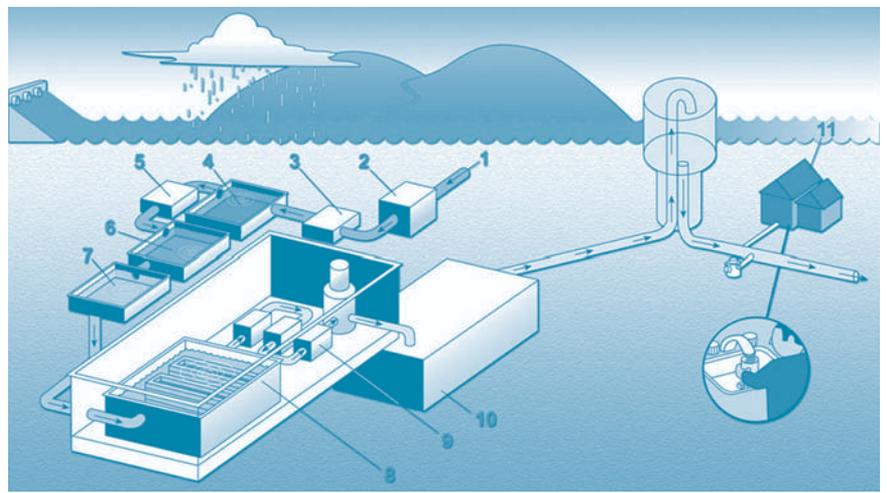

# SOURCE WATER ASSESSMENT INFORMATION

A high-quality source water supply allows the Division of Water to provide consumers with quality water at a reasonable cost. Protecting our raw water sources requires investments to secure the needs of a growing population, now and in the future. As part of its on-going efforts to maintain regulatory compliance and monitor our water supply, the Division of Water has completed a Source Water Assessment process. Below is a synopsis of the results.

The City of Columbus water system uses surface water from the Scioto River and Big Walnut Creek, as well as ground water pumped from sand and gravel deposits of the Scioto River Valley. All three sources of water have a relatively high susceptibility to contamination from spills or releases of chemicals. The ground water pumped at the Parsons Avenue plant is susceptible (compared to other ground water systems) because there is no significant clay overlying and protecting the aquifer deposits. The Scioto River and Big Walnut Creek are even more susceptible because they are more accessible and less protected from spills.

The drinking water source protection areas for the City of Columbus' three water sources contain numerous potential contaminant sources, especially the protection area for the Dublin Road Water Treatment Plant (extending along the Scioto River). These include industrial activities, storm water run-off from developing areas, and a heavily traveled transportation network running alongside and over the water bodies. Run-off from agricultural fields is a concern in both the Scioto River and Big Walnut Creek watersheds.

The City of Columbus treats the water to meet drinking water quality standards, but no single treatment protocol can address all potential contaminants. The City has been proactive in pursuing measures to further protect its source waters. These include land stewardship programs and incentive-driven programs to reduce erosion and run-off of pesticides and fertilizers into the Scioto River and Big Walnut Creek and their reservoirs. More detailed information is provided in the City of Columbus' Drinking Water Source Assessment Report, which can be viewed by calling the Watershed section at (614) 645-1721. Visit [www.columbus.gov/watershed/](http://www.columbus.gov/watershed/) for more details about watershed management and the land stewardship program.



# QUESTIONS & ANSWERS ABOUT WATER QUALITY ISSUES IN RECENT NEWS

## LEAD IN WATER

U.S. water operators are required to comply with all federal Safe Drinking Water Act rules and state regulations, including the Lead and Copper Rule. The City of Columbus is in compliance with all state and federal drinking water regulations. The Division of Water's highly qualified professionals take their jobs of protecting public health by providing safe drinking water very seriously.

There is no lead in the treated water that leaves the Columbus water treatment plants, nor in the source water these plants use. None of the water mains in the Columbus water system are made of lead. However, because some water service lines, home plumbing, fixtures and solder may contain lead materials or parts, precautions are taken to prevent lead from leaching into the water at the tap.

**What does Columbus do to prevent lead from getting in the tap water?** Columbus has a very effective corrosion protection program. To prevent corrosive conditions that could cause leaching of lead, certified water operators adjust the water's chemistry and add zinc orthophosphate to the treated water. This reduces the corrosiveness of the water and creates a coating inside the pipes to serve as a barrier between the pipes and water.

Testing is done to ensure this corrosion protection program continues to perform well. As required by Ohio EPA, 50 homes in the Columbus water distribution system are tested every three years for lead. In addition, various site samples are voluntarily tested monthly for lead.

**I live in a home with older plumbing. How can I know if there may be lead at my tap?** Most homes in the Columbus area do not have lead service lines and have little to no detectable levels of lead in their tap water. To find out if your home has a city owned lead service line, call our lab at (614) 645-7691. However, the only way to know with certainty if there may be lead at the tap is to have the water tested by a certified laboratory. State approved labs are published in our "Lead in Drinking Water" publication found online at [www.columbus.gov/LeadInWater/](http://www.columbus.gov/LeadInWater/).

All customers can protect themselves from lead or other contaminants by following this recommendation, regardless of the age of a home: whenever water has not been used for 6 hours or more, run the tap for 30 seconds to two minutes, until the water is cold. This ensures one is using fresh water from the city's mains, rather than water that has been sitting in a building's pipes.

## NITRATE, ALGAE AND RELATED TASTE & ODOR ISSUES

**What causes nitrate alerts, like what occurred in June 2015?** A nitrate alert is usually caused

when heavy rains wash fertilizer from farmland, lawns and golf courses into our water supplies. Please see our Newborns and Nitrate section on the opposite side and visit [www.columbus.gov/NitrateFAQs/](http://www.columbus.gov/NitrateFAQs/). **What is Columbus doing to prevent nitrate levels from rising?** Staff work with agricultural and reservoir adjacent landowners to encourage environmental stewardship and conservation practices; green infrastructure is utilized around our reservoirs, and a new \$40 million nitrate removal facility is under construction at the Dublin Road plant to be completed in 2017.

**Are algal blooms a concern in central Ohio?** Algae are naturally occurring organisms that are always present in surface water, but how much and what kind is what matters. While most algae are harmless and cause no issues to the water treatment process, some types at higher levels can cause taste and odor issues or may be harmful to humans and pets.

Columbus monitors regularly for algal growth in its surface water reservoirs, along with other possible contaminants. The type of algae we may experience in Columbus can present a foul taste and odor described as musty or earthy and while unpleasant, poses no health concerns. Once detected, our operators add powdered activated carbon and potassium permanganate to help eliminate the taste and odor.

**Could Columbus experience a harmful algal bloom?** Harmful algae could grow in our reservoirs, however, Columbus has many tools and options to address such an issue. In addition to treatment and powdered activated carbon, we have flexibility through our varied water resources, to withdraw water from different levels within our reservoirs; and an expert algal research and monitoring program.

Additionally, the city has been proactive in planning and will be bringing new treatment technologies online within the next year at the Hap Cremean and Dublin Road water plants. These new technologies, including ozone and biologically active carbon filtration, will add to our treatment capabilities and also combat any taste and odor aspects that can occur with varied blooms, harmful or otherwise.

**Can residents help protect water quality?** While some issues of concern are often related to upstream agricultural activity, **we all play a role in water protection.** Some simple steps you can take at home to help protect our water source include: limiting lawn chemicals, picking up pet waste, disposing of household hazardous waste properly, maintaining septic tank systems and fixing automotive leaks. Planting trees and deep rooted native plants can aid in filtering pollutants that are often carried in stormwater that washes over the land as it travels to the nearest waterway. Please visit [www.columbus.gov/KeepItClean/](http://www.columbus.gov/KeepItClean/) for more information on how you can help "Keep It Clean."

